


SECOND ENTRANCE  
STRONGLY RECOMMENDED  
FOR VENTILATION,  
LIGHTING AND SAFETY

CLEANOUT OUTSIDE INTERCEPTOR  
TO BE LOCATED IN CONFORMANCE  
WITH COMAR 09.04

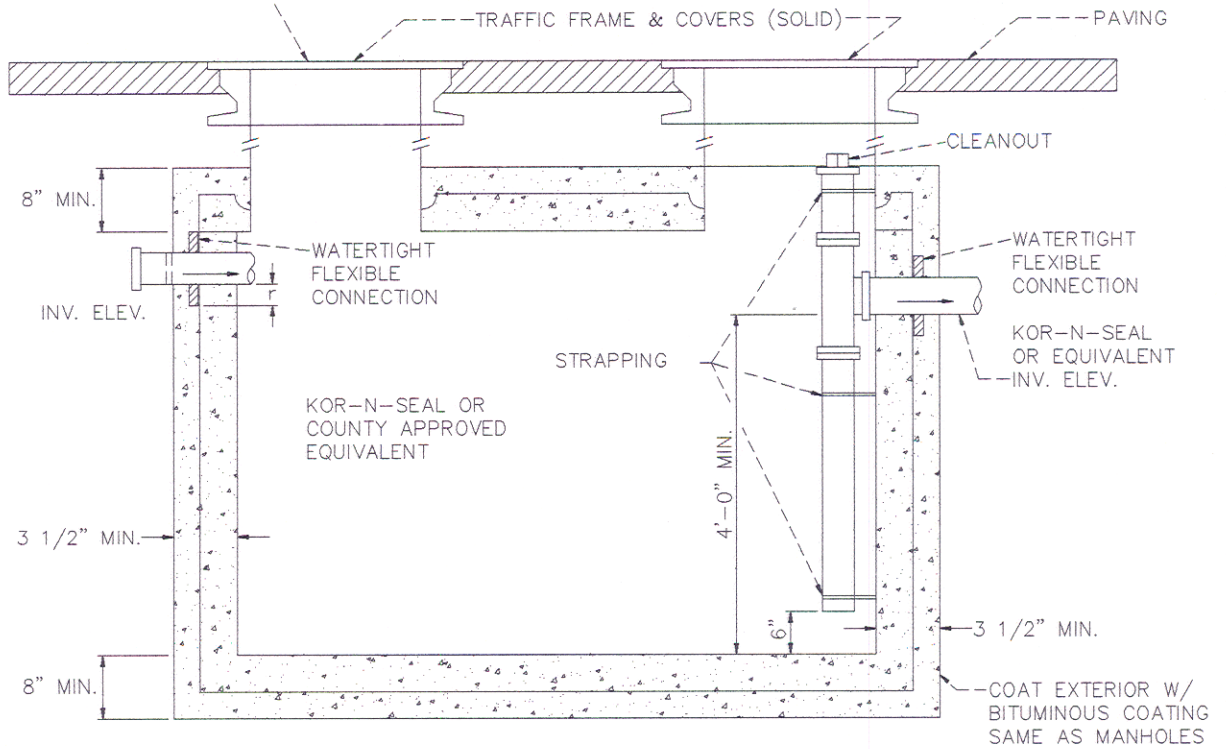

USE SCHEDULE 40 PVC PIPE AND FITTINGS

1000 GAL. MIN.

1500 GAL. 201-300 SEATS

2000 GAL. 301-400 SEATS

TANK AND ALL COMPONENTS SHALL BE DESIGNED FOR TRUCK LOADINGS (1-120).

LARGER AS DIRECTED BY  
WATER / SEWER ENGINEER  
UPON REVIEW OF MENU ITEMS

NOTES:

(1) PROVIDE STRAPPING ON INTERIOR VERTICAL CLEANOUT STACK  
STARTING AT 6" ON EACH END OF PIPE AND EVERY 3.0'.

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED:

*[Signature]* 6/29/95  
DIRECTOR OF DEVELOPMENT SERVICES DATE  
*[Signature]* 6/29/95  
WATER / SEWER ENGINEER DATE

STANDARD DETAIL

OUTSIDE  
GREASE TRAP

REVISIONS:

S  
5.04